


-15kV TOF: -9181 v
 -3.6kV MCP: -3364 v
 -2.4kV MCP: -1784 v
 Input Cur: 310 ma
 RPA max: 237 v
 Mirror max: 238 v

Wed Nov 15 10:34:45 2006

TIDE Direct Events

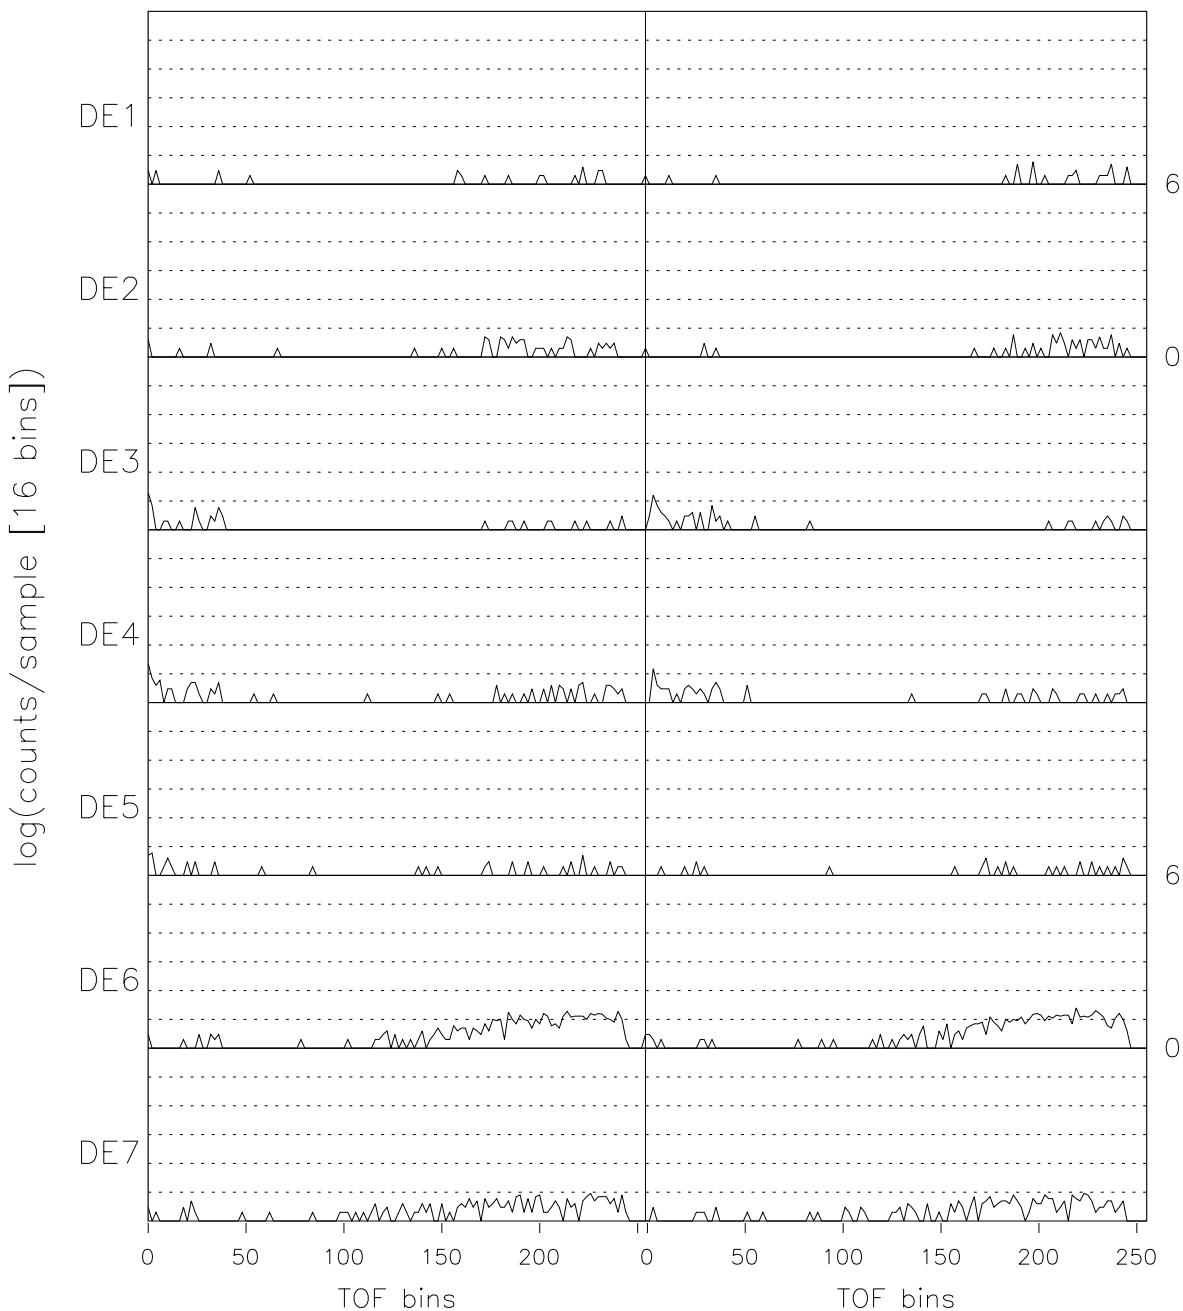

reported: 10-06-06 16:23:56 UT

reported: 10-06-06 16:27:08 UT

file: /export/data/tide/nrt/06100601.dat

-15kV TOF: -9181 v
-3.6kV MCP: -3364 v
-2.4kV MCP: -1784 v
Input Cur: 316 ma
RPA max: 237 v
Mirror max: 238 v